


PERFORMANCE
MADE
SMARTER

Product manual

3186A: 2-wire transmitter isolator

3186B: 2-wire current isolator

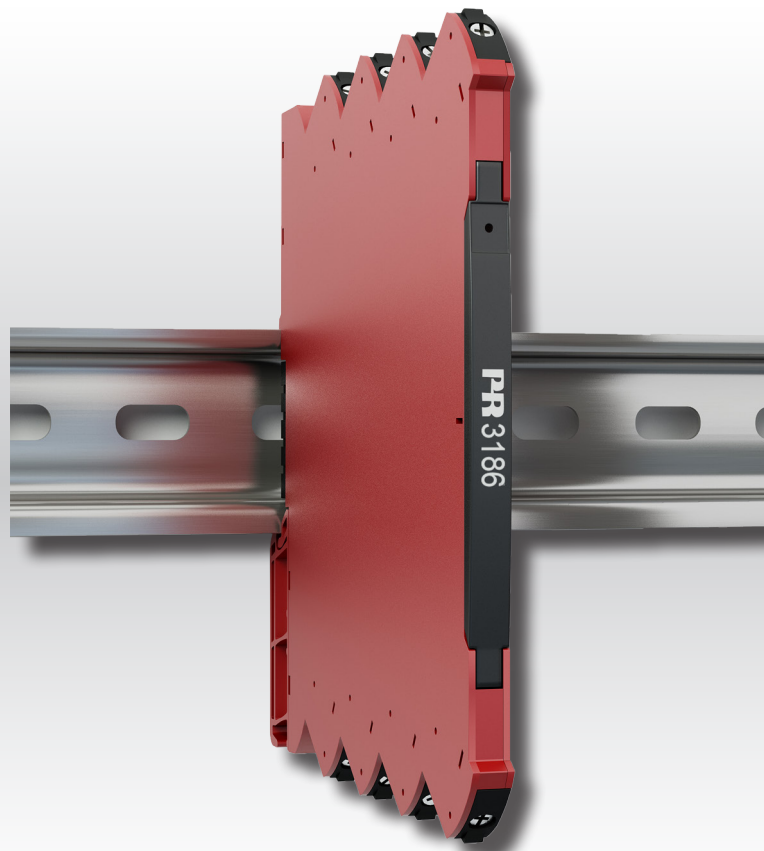

TEMPERATURE | I.S. INTERFACES | COMMUNICATION INTERFACES | MULTIFUNCTIONAL | ISOLATION | DISPLAY

No. 3186V103-UK
From serial no.: 221319037

PR
electronics

6 Product Pillars

to meet your every need

Individually outstanding, unrivalled in combination

With our innovative, patented technologies, we make signal conditioning smarter and simpler. Our portfolio is composed of six product areas, where we offer a wide range of analog and digital devices covering over a thousand applications in industrial and factory automation. All our products comply with or surpass the highest industry standards, ensuring reliability in even the harshest of environments and have a 5-year warranty for greater peace of mind.



Temperature

Our range of temperature transmitters and sensors provides the highest level of signal integrity from the measurement point to your control system. You can convert industrial process temperature signals to analog, bus or digital communications using a highly reliable point-to-point solution with a fast response time, automatic self-calibration, sensor error detection, low drift, and top EMC performance in any environment.



I.S. Interface

We deliver the safest signals by validating our products against the toughest safety standards. Through our commitment to innovation, we have made pioneering achievements in developing I.S. interfaces with SIL 2 Full Assessment that are both efficient and cost-effective. Our comprehensive range of analog and digital intrinsically safe isolation barriers offers multifunctional inputs and outputs, making PR an easy-to-implement site standard. Our backplanes further simplify large installations and provide seamless integration to standard DCS systems.



Communication

We provide inexpensive, easy-to-use, future-ready communication interfaces that can access your PR installed base of products. All the interfaces are detachable, have a built-in display for readout of process values and diagnostics, and can be configured via push-buttons. Product specific functionality includes communication via Modbus and Bluetooth and remote access using our PR Process Supervisor (PPS) application, available for iOS and Android.



Multifunction

Our unique range of single devices covering multiple applications is easily deployable as your site standard. Having one variant that applies to a broad range of applications can reduce your installation time and training, and greatly simplify spare parts management at your facilities. Our devices are designed for long-term signal accuracy, low power consumption, immunity to electrical noise and simple programming.



Isolation

Our compact, fast, high-quality 6 mm isolators are based on microprocessor technology to provide exceptional performance and EMC-immunity for dedicated applications at a very low total cost of ownership. They can be stacked both vertically and horizontally with no air gap separation between units required.



Display

Our display range is characterized by its flexibility and stability. The devices meet nearly every demand for display readout of process signals and have universal input and power supply capabilities. They provide a real-time measurement of your process value no matter the industry and are engineered to provide a user-friendly and reliable relay of information, even in demanding environments.

3186A: 2-wire transmitter isolator

3186B: 2-wire current isolator

Table of contents

Warnings	4
Symbol identification	4
Safety instructions	5
Mounting / demounting of system 3000	6
Installation on DIN rail	7
Marking	7
Application	8
Technical characteristics	8
Mounting / installation	8
Connections	9
Order	10
Technical data	10
Installation instructions	13
UL installation	13
IECEX, ATEX and UKEX installation in Zone 2	13
cFMus installation in Division 2 or Zone 2	13
Document history	14

Warnings



GENERAL

To avoid the risk of electric shock and fire, the safety instructions of this product manual must be observed, and the guidelines followed. The specifications must not be exceeded, and the device must only be applied as described in the following.

Prior to the commissioning of the device, this product manual must be examined carefully.

Only qualified personnel (technicians) should install this device. If the equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.

To avoid explosion and serious injury: Modules having mechanical failures must be returned to PR electronics for repair or replacement.

Repair of the device and replacement of circuit breakers must be done by PR electronics A/S only.



**HAZARDOUS
VOLTAGE**

Until the device is fixed, do not connect hazardous voltages to the device.

In applications where hazardous voltage is connected to in-/outputs of the device, sufficient spacing or isolation from wires, terminals, and enclosure - to surroundings (incl. neighboring devices), must be ensured to maintain protection against electric shock.



CAUTION

Potential electrostatic charging hazard. To avoid the risk of explosion due to electrostatic charging of the enclosure, do not handle the units unless the area is known to be safe, or appropriate safety measures are taken to avoid electrostatic discharge.

Symbol identification



Triangle with an exclamation mark: Warning /demand. Potentially lethal situations. Read the manual before installation and commissioning of the device in order to avoid incidents that could lead to personal injury or mechanical damage.



The CE mark proves the compliance of the device with the essential requirements of the EU directives.



The UKCA mark proves the compliance of the device with the essential requirements of the UK regulations.



Ex devices have been approved acc. to the ATEX directive for use in connection with installations in explosive areas. See installation instructions.

Safety instructions

Receipt and unpacking

Unpack the device without damaging it and check whether the device type corresponds to the one ordered. The packing should always follow the device until this has been permanently mounted.

Environment

Avoid direct sun light, dust, high temperatures, mechanical vibrations and shock, and rain and heavy moisture. If necessary, heating in excess of the stated limits for ambient temperatures should be avoided by way of ventilation.

The device must be installed in pollution degree 2 or better.

The device is designed to be safe at least under an altitude up to 2000 m.

The device is designed for indoor use.

Mounting

Only technicians who are familiar with the technical terms, warnings, and instructions in the manual and who are able to follow these should connect the device. Should there be any doubt as to the correct handling of the device, please contact your local distributor or, alternatively,

PR electronics A/S
www.prelectronics.com

Mounting and connection of the device should comply with national legislation for mounting of electric materials, e.g. wire cross section, protective fuse, and location.

Descriptions of input / output and supply connections are shown in the block diagram and side label.

The device is provided with field wiring terminals and shall be supplied from a Power Supply having double / reinforced insulation. A power switch should be easily accessible and close to the device. The power switch shall be marked as the disconnecting unit for the device.

SYSTEM 3000 must be mounted on a DIN rail according to EN 60715.

Year of manufacture can be taken from the first two digits in the serial number.



Cleaning

When disconnected, the device may be cleaned with a cloth moistened with distilled water.


Liability

To the extent the instructions in this manual are not strictly observed, the customer cannot advance a demand against PR electronics A/S that would otherwise exist according to the concluded sales agreement.

Mounting / demounting of system 3000

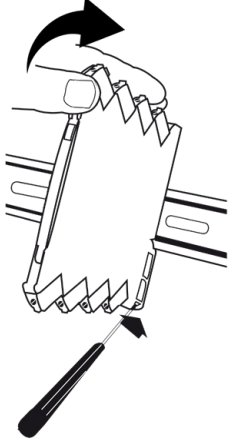Mounting on DIN rail (Fig.1)	Demounting from DIN rail (Fig.2)
<p data-bbox="268 225 571 257">Click the device onto the rail</p>	<p data-bbox="810 225 1385 353">First, remember to demount the connectors with hazardous voltages. Detach the device from the rail by moving the bottom lock down.</p>
 A line drawing showing a hand holding a rectangular device with a serrated bottom edge. The device is being moved towards a horizontal DIN rail. A curved arrow above the hand indicates the direction of movement, pointing towards the rail.	 A line drawing showing a hand holding a device that is already mounted on a DIN rail. A screwdriver is being used to push down on a small tab at the bottom of the device. A curved arrow above the hand indicates the direction of movement, pointing upwards.


Installation on DIN rail

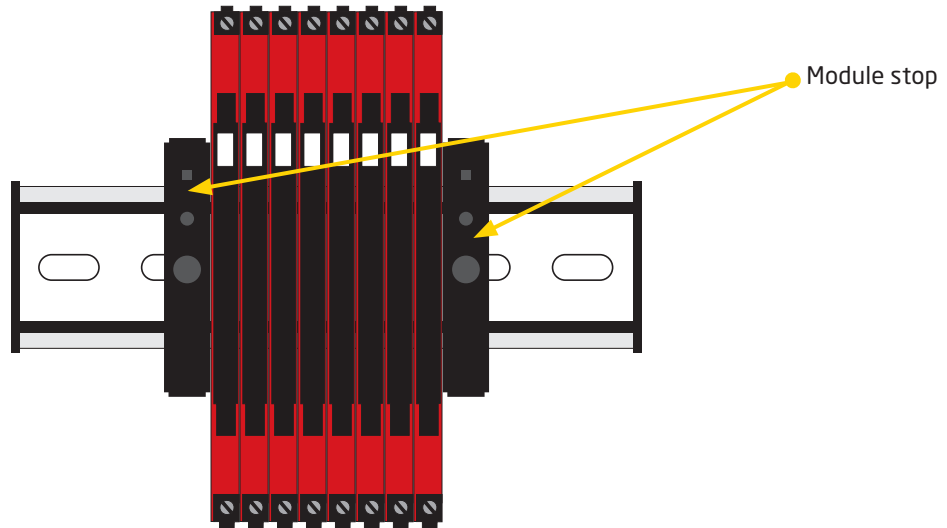

For marine applications, the devices must be supported by a module stop (PR part number 9404).

Marking

The front cover of the 3000 devices has been designed with an area for affixation of a click-on marker. The area assigned to the marker measures 5 x 7.5 mm. Markers from Weidmüller's MultiCard System, type MF 5/7.5, are suitable.

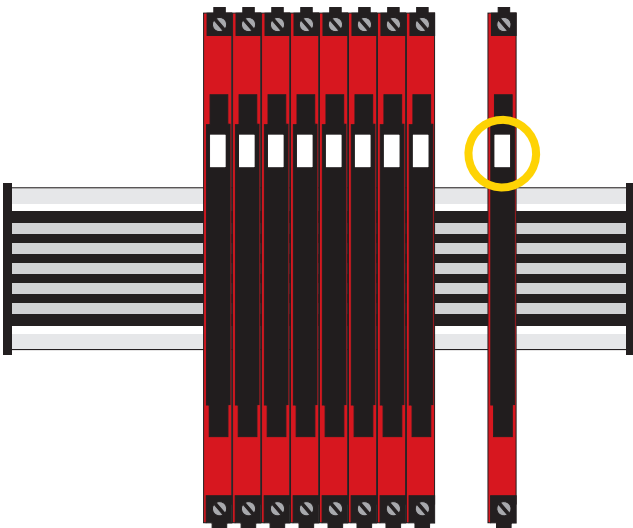

3186A: 2-wire transmitter isolator

3186B: 2-wire current isolator

- 1 or 2 channel 2-wire transmitter isolator / current isolator
- 1:1 conversion in the range 3.5...23 mA
- Low voltage drop and fast response time < 5 ms
- Excellent accuracy, better than 0.05%
- Slimline 6.1 mm housing

Application

- 3186A is a 1:1 output loop-powered 2-wire transmitter isolator that excites and measures passive input signals.
- 3186B is a 1:1 output loop-powered 2-wire current isolator that measures active input signals.
- A very competitive choice in terms of both price and technology for galvanic isolation.
- Provides surge suppression and protects control systems from transients and noise.
- Elimination of ground loops and measurement of floating signals.
- The device can be mounted in Safe area or in Zone 2 and Cl. 1 Div 2. area.

Technical characteristics


- 3186 is powered by the host loop voltage.
- Wide supply range from 6...35 V.
- Low input to output voltage drop typ. 2.5 V (3186A).
- Low input drop ≤ 3 V (3186B), even when no loop power is applied to the output terminals.
- Excellent conversion accuracy, better than 0.05% in the range 3.8...20.5 mA.
- Signal range is 3.5...23 mA which means that 3186 is NAMUR NE43 compliant.
- Inputs and outputs are floating and galvanically separated.
- High galvanic isolation of 2.5 kVAC.
- Fast response time < 5 ms.
- Excellent signal/noise ratio > 60 dB.

Mounting / installation


- DIN rail mounting with upto 330 channels per metre.
- Extended operating temperature range from -25...+70°C.

Connections

3186A

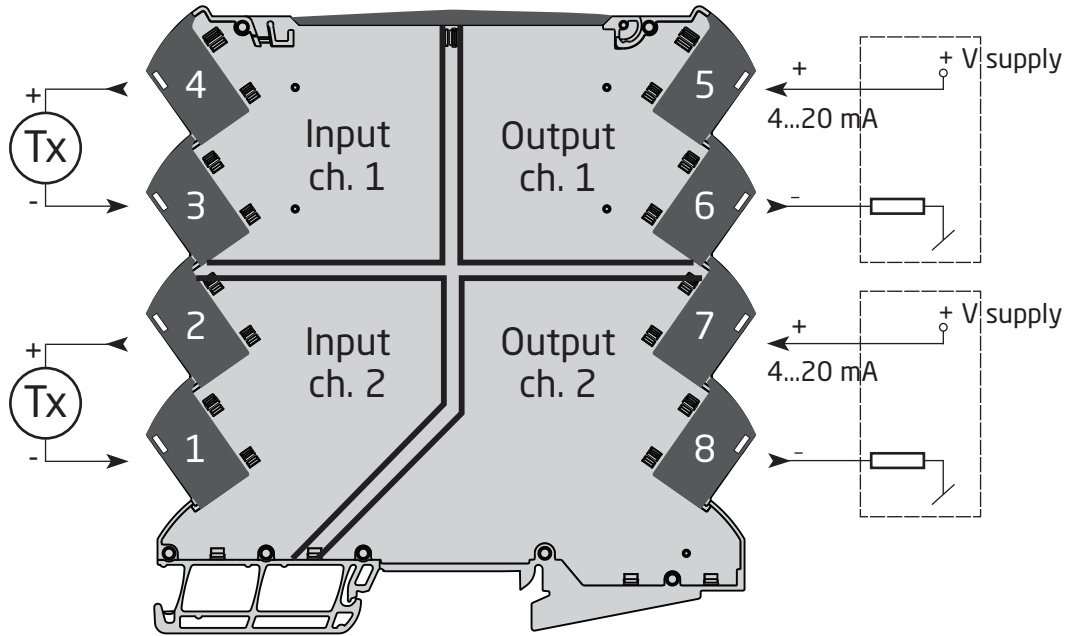

3186B

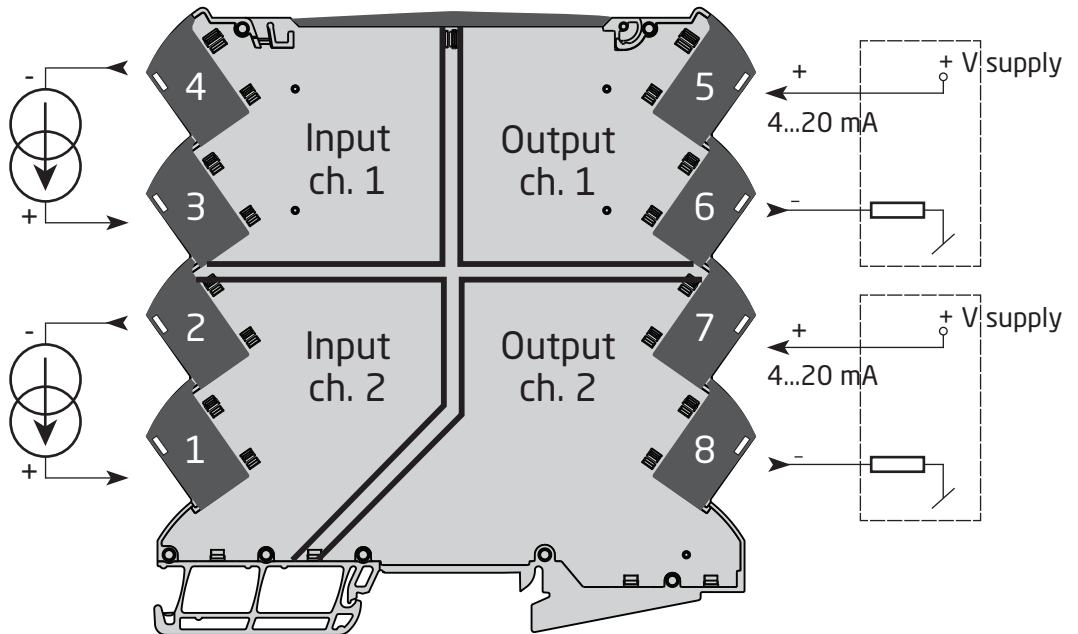

*Safe Area or
Zone 2 & Cl. 1, Div. 2, gr. A-D*

Order

Type	Version	Unit channels
3186	2-wire transmitter isolator : A	Single : 1
	2-wire current isolator : B	Double : 2

Example: 3186B2

Accessories

9404 = Module stop for rail

Technical data

Environmental conditions:

Operating temperature -25°C to +70°C
Storage temperature -40°C to +85°C
Calibration temperature. 20...28°C
Relative humidity < 95% RH (non-cond.)
Protection degree IP20
Installation in pollution degree 2 & overvoltage category II.

Mechanical specifications:

Dimensions (HxWxD) 113 x 6.1 x 115 mm
Weight approx. 70 g
DIN rail type. DIN EN 60715 - 35 mm
Wire size. 0.13...2.5 mm² / AWG 26...12 stranded wire
Screw terminal torque. 0.5 Nm
Vibration. IEC 60068-2-6
2...25 Hz. ±1,6 mm
25...100 Hz ±4 g

Common electrical specifications:

Supply voltage 6...35 VDC
Voltage drop, input to output typ. (3186A) 2.5 V
Input voltage drop typ. (3186B)
Supplied and non-supplied unit ≤ 3 V
Isolation voltage, test 2.5 kVAC
Working isolation voltage. 300 VAC / 250 VAC (Ex)
Signal dynamics, input / output Analog signal chain
Signal / noise ratio. > 60 dB
Response time (0...90%, 100...10%). < 5 ms
Cut-off frequency (3 dB) 100 Hz


Power dissipation

3186A. 50 mW per channel
3186B. Vterminal x I per channel

In order to ensure that the maximum internal temperature is not exceeded, the following exceptions must be followed for the 3186B1 & B2.

3186B1


Power dissipation @ $T_{amb.} = 70^{\circ}\text{C}$:

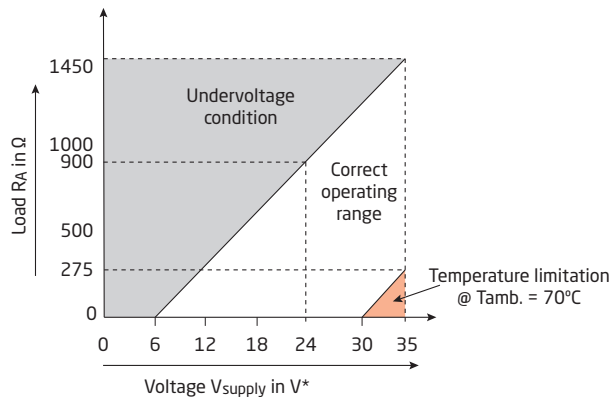


Power dissipation @ $T_{amb.} = 60^{\circ}\text{C}$ No limiting issues within operating range

3186B2

Power dissipation @ $T_{amb.} = 70^{\circ}\text{C}$:

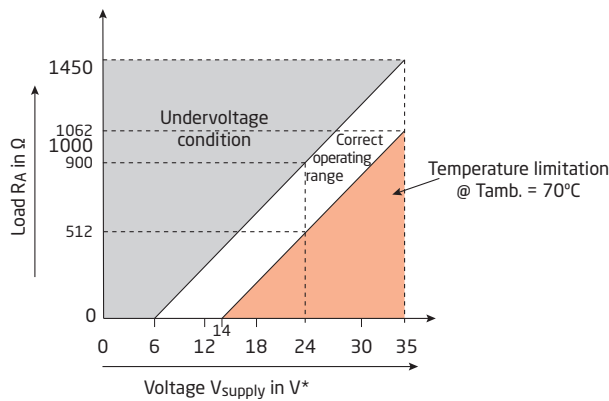

Power dissipation @ $T_{amb.} = 60^{\circ}\text{C}$:

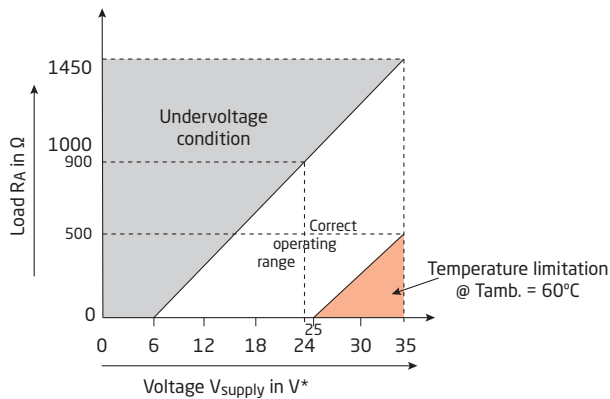

Power dissipation @ $T_{amb.} = 50^{\circ}\text{C}$ No limiting issues within operating range

* V_{supply} : The supply voltage for the loop covering both the 3186 output terminal voltage and the voltage across the load resistor R_A .

R_A = The input impedance in the PLC + the load in the loop (incl. the cable resistance).

Input and output specifications:

Available input transmitter (Tx) supply (3186A)	3.5...32.5 V
Signal range, input to output	3.8...20.5 mA
Signal conversion	1:1
Signal range.	3.5...23 mA
Output loop current limitation, typ	24 mA
Current output overload, max	50 mA

Accuracy values - 3186A				
Input type	Absolute accuracy	Temperature coefficient $\Delta^{\circ}\text{C} = [\text{T}_{\text{amb.}} - 25^{\circ}\text{C}]$		
mA	$\leq \pm 8 \mu\text{A}$		$\text{T}_{\text{amb.}} > 25^{\circ}\text{C}$	$\text{T}_{\text{amb.}} < 25^{\circ}\text{C}$
		For $V_{\text{terminal}} \leq 24 \text{ V}$	$\text{T}_{\text{coeff.}} = \pm 0.48 \mu\text{A}/^{\circ}\text{C}$	$\text{T}_{\text{coeff.}} = \pm 1.68 \mu\text{A}/^{\circ}\text{C}$
		For $V_{\text{terminal}} > 24 \text{ V}$	$\text{T}_{\text{coeff.}} = \pm 0.02 \mu\text{A}/^{\circ}\text{C} \times V_{\text{terminal}}^{**}$	$\text{T}_{\text{coeff.}} = \pm 0.047 \mu\text{A}/^{\circ}\text{C} \times V_{\text{terminal}}^{**}$

Accuracy values - 3186B				
Input type	Absolute accuracy	Temperature coefficient $\Delta^{\circ}\text{C} = [\text{T}_{\text{amb.}} - 25^{\circ}\text{C}]$		
mA	$\leq \pm 8 \mu\text{A}$		$\text{T}_{\text{amb.}} > 25^{\circ}\text{C}$	$\text{T}_{\text{amb.}} < 25^{\circ}\text{C}$
		For $V_{\text{terminal}} \leq 24 \text{ V}$	$\text{T}_{\text{coeff.}} = \pm 0.48 \mu\text{A}/^{\circ}\text{C}$	$\text{T}_{\text{coeff.}} = \pm 1.12 \mu\text{A}/^{\circ}\text{C}$
		For $V_{\text{terminal}} > 24 \text{ V}$	$\text{T}_{\text{coeff.}} = \pm 0.02 \mu\text{A}/^{\circ}\text{C} \times V_{\text{terminal}}^{**}$	$\text{T}_{\text{coeff.}} = \pm 0.047 \mu\text{A}/^{\circ}\text{C} \times V_{\text{terminal}}^{**}$

** V_{terminal} : Output terminal voltage measured in V at the 3186 device, i.e. voltage between terminal 5 and 6 for channel 1 and between terminal 7 and 8 for channel 2.

EMC - immunity influence.	< $\pm 0.5\%$ of span
Extended EMC immunity:	
NAMUR NE 21, A criterion, burst	< $\pm 1\%$ of span

of span = 4...20 mA

Observed authority requirements:

EMC.	2014/30/EU & UK SI 2016/1091
LVD	2014/35/EU & UK SI 2016/1101
RoHS.	2011/65/EU & UK SI 2012/3032
ATEX	2014/34/EU & UK SI 2016/1107
EAC	TR-CU 020/2011
EAC Ex	TR-CU 012/2011

Approvals:

DNV, Ships & Offshore.	TAA00001RW
c UL us, UL 61010-1.	E314307

I.S. / Ex approvals:

ATEX	KEMA 10ATEX0147 X
IECEx.	KEM 10.0068 X
UKEX.	DEKRA 21UKEX0055X
c FM us.	FM17US0004X / FM17CA0003X
CCC	2020322310003554
EAC Ex	RU C-DK.HA65.B.00355/19

Installation instructions

UL installation

Use 60/75°C copper conductors only.

Wire size AWG 26-12

UL file number E314307

The device is an Open Type Listed Process Control Equipment. To prevent injury resulting from accessibility to live parts the equipment must be installed in an enclosure. The power Supply unit must comply with NEC Class 2, as described by the National Electrical Code® (ANSI / NFPA 70).

IECEX, ATEX and UKEX installation in Zone 2

IECEX KEM 10.0068 X Ex ec IIC T4 Gc

KEMA 10ATEX0147 X I 3 G Ex ec IIC T4 Gc

DEKRA 21UKEX0055X II 3 G Ex ec IIC T4 Gc

For safe installation, the following must be observed. The device shall only be installed by qualified personnel who are familiar with the national and international laws, directives and standards that apply to this area.

The devices shall be installed in a suitable enclosure providing a degree of protection of at least IP54 according to EN IEC 60079-0, taking into account the environmental conditions under which the equipment will be used.

When the temperature under rated conditions exceeds 70°C at the cable or conduit entry point, or 80°C at the branching point of the conductors, the temperature specification of the selected cable shall be in compliance with the actual measured temperature.

To prevent ignition of the explosive atmospheres, disconnect power before servicing and do not separate connectors when energized and an explosive gas mixture is present.

For installation on power rail in Zone 2, only Power Rail type 9400 supplied by Power Control Unit type 9410 is allowed.

Do not mount or remove devices from the power rail when an explosive gas mixture is present.

cFMus installation in Division 2 or Zone 2

FM17CA0003X / FM17US0004X Class I, Div. 2, Group A, B, C, D T4 or

Class I, Zone 2, AEx nA IIC T4 or Ex nA IIC T4

In class I, Division 2 or Zone 2 installations, the subject equipment shall be mounted within a tool-secured enclosure which is capable of accepting one or more of Class I, Division 2 wiring methods specified in the National Electrical Code (ANSI/NFPA 70) or in Canada in the Canadian Electrical Code (C22.1).

The 3000 System Isolators and Converters must be connected to limited output NEC Class 2 circuits, as outlined in the National Electrical Code® (ANSI / NFPA 70), only. If the devices are connected to a redundant power supply (two separate power supplies), both must meet this requirement.

Where installed in outdoor or potentially wet locations the enclosure shall at a minimum meet the requirements of IP54.

Warning: Substitution of components may impair suitability for zone 2 / division 2.

Warning: To prevent ignition of the explosive atmospheres, disconnect power before servicing and do not separate connectors when energised and an explosive gas mixture is present.

Warning: Do not mount or remove devices from the power rail when an explosive gas mixture is present.

Document history

The following list provides notes concerning revisions of this document.

Rev. ID	Date	Notes
101	1710	Model 3186B added. Specifications for power dissipation added. PESO/CCOE approval added.
102	2108	PESO/CCOE approval discontinued . CCC approval added. ATEX and IECEx approvals updated - Ex na changed to Ex ec.
103	2205	Side label updated. UKEX approval added.

We are near you, *all over the world*

Our trusted red boxes are supported wherever you are

All our devices are backed by expert service and a 5-year warranty. With each product you purchase, you receive personal technical support and guidance, day-to-day delivery, repair without charge within the warranty period and easily accessible documentation.

We are headquartered in Denmark, and have offices and authorized partners the world over. We are a local

business with a global reach. This means that we are always nearby and know your local markets well. We are committed to your satisfaction and provide **PERFORMANCE MADE SMARTER** all around the world.

For more information on our warranty program, or to meet with a sales representative in your region, visit prelectronics.com.

Benefit today from *PERFORMANCE MADE SMARTER*

PR electronics is the leading technology company specialized in making industrial process control safer, more reliable and more efficient. Since 1974, we have been dedicated to perfecting our core competence of innovating high precision technology with low power consumption. This dedication continues to set new standards for products communicating, monitoring and connecting our customers' process measurement points to their process control systems.

Our innovative, patented technologies are derived from our extensive R&D facilities and from having a great understanding of our customers' needs and processes. We are guided by principles of simplicity, focus, courage and excellence, enabling some of the world's greatest companies to achieve PERFORMANCE MADE SMARTER.